

Every 5 years Lead in Water testing for the Climax Shelly School District.

Lead in Water test results received 4-9-24. Test results must be made available to the public within 30 days of receiving the test results.


Testing commenced in November of 2023. 12 sites were tested. To pass the test for human consumption, test levels of lead in the water must be below 5 parts per billion. This is a MN Dept of Health requirement. The results of the 12 sites tested are as follows:

1. Pass
2. Pass
3. Pass
4. 23 parts per billion
 - a. This is not a site that involves human consumption as all food in the steamer is enclosed and does not come in contact with the water.
5. Pass
6. Pass
7. Pass
8. Pass
9. Pass
10. Pass
11. Pass
12. Pass

For complete testing results, please contact the supt.

Water Lead Testing

- 01 - Water Fountain
- 02 - Bottle Filler
- 03 - Sink
- 04 - Steamer
- 05 - Water Fountain
- 06 - Bottle Filler
- 07 - Water Fountain
- 08 - Bottle Filler
- 09 - Water Fountain
- 10 - Water Fountain
- 11 - Bottle Filler
- 12 - Water Fountain

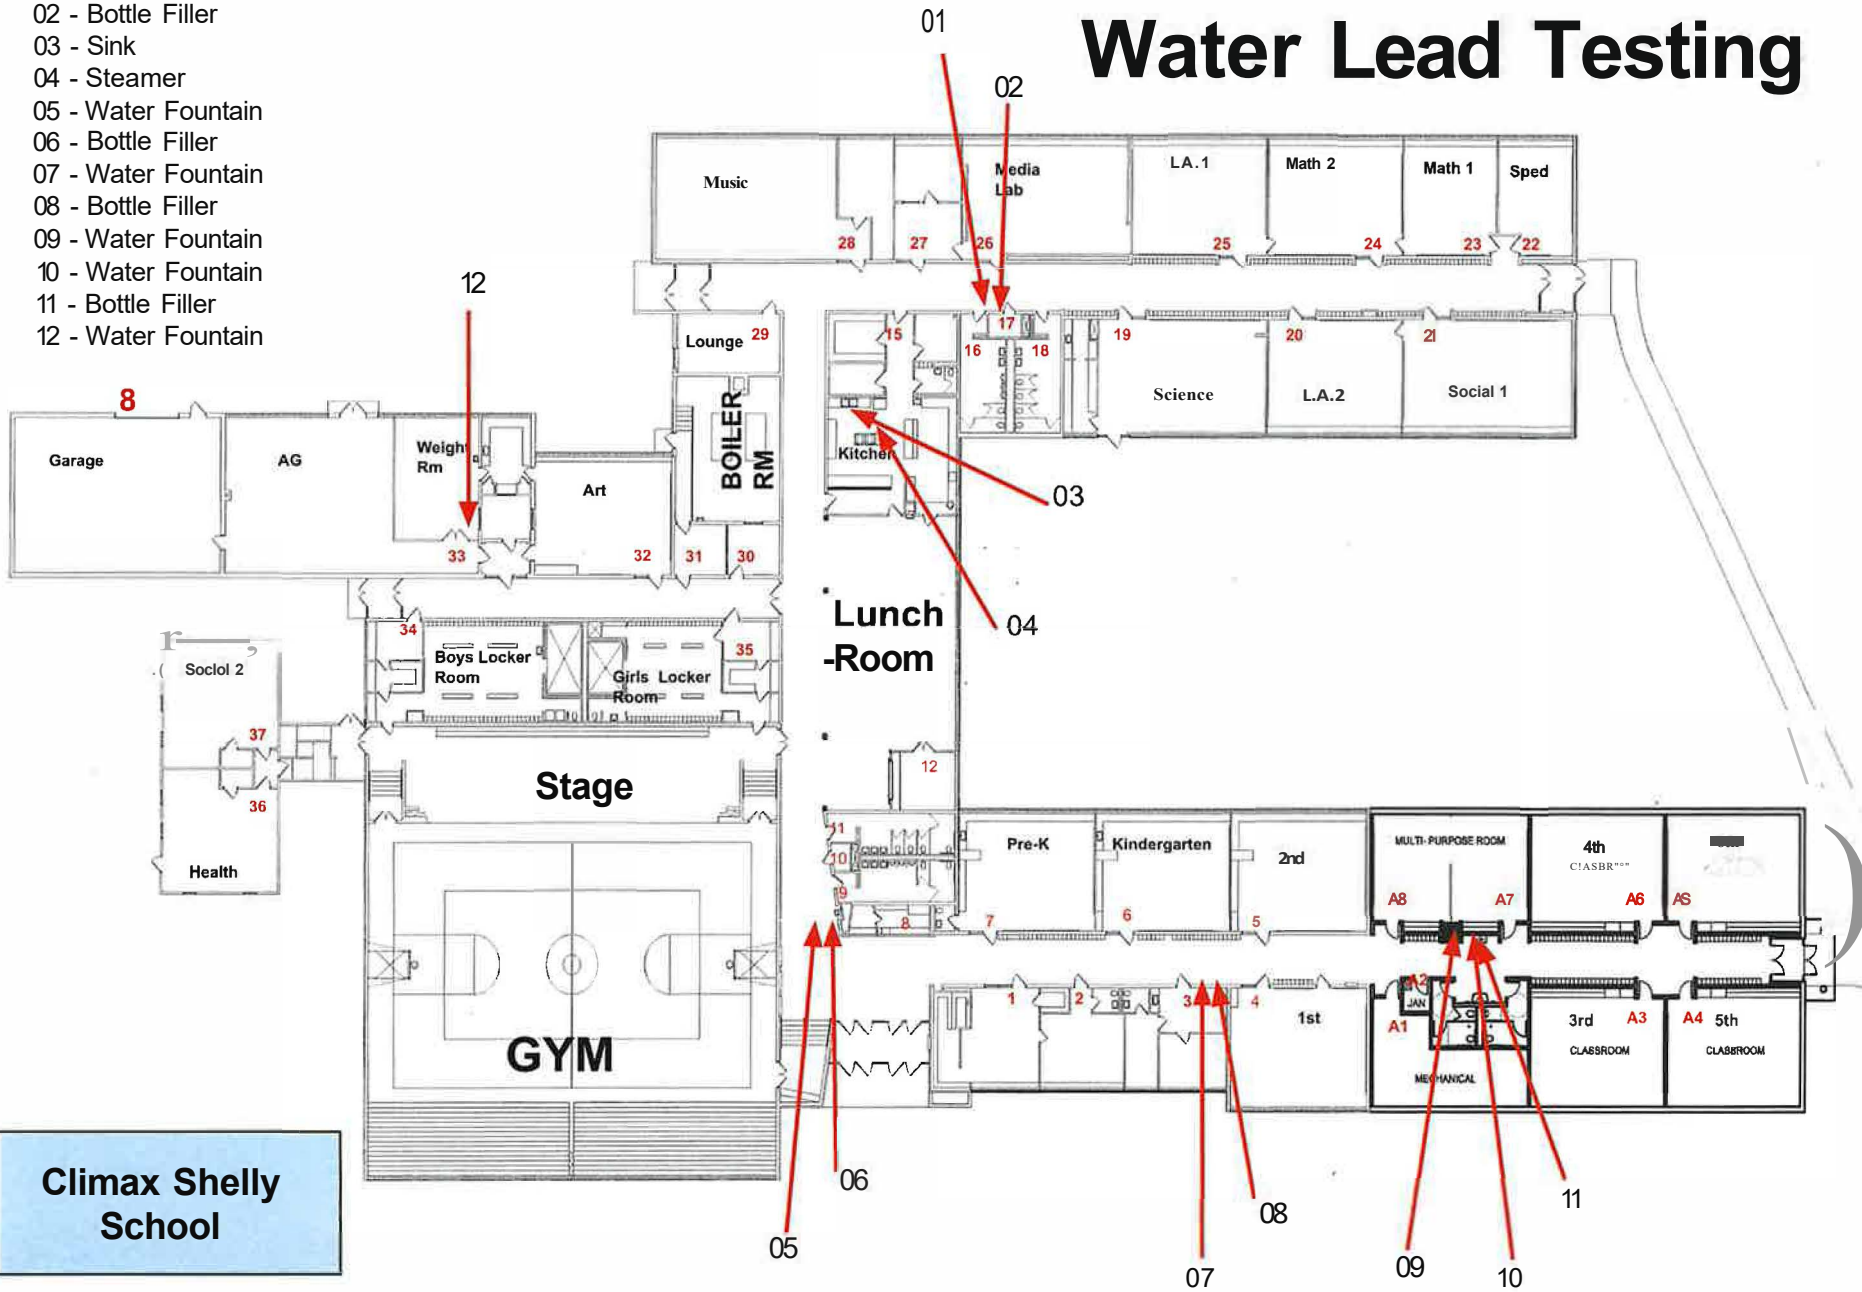

Climax Shelly School